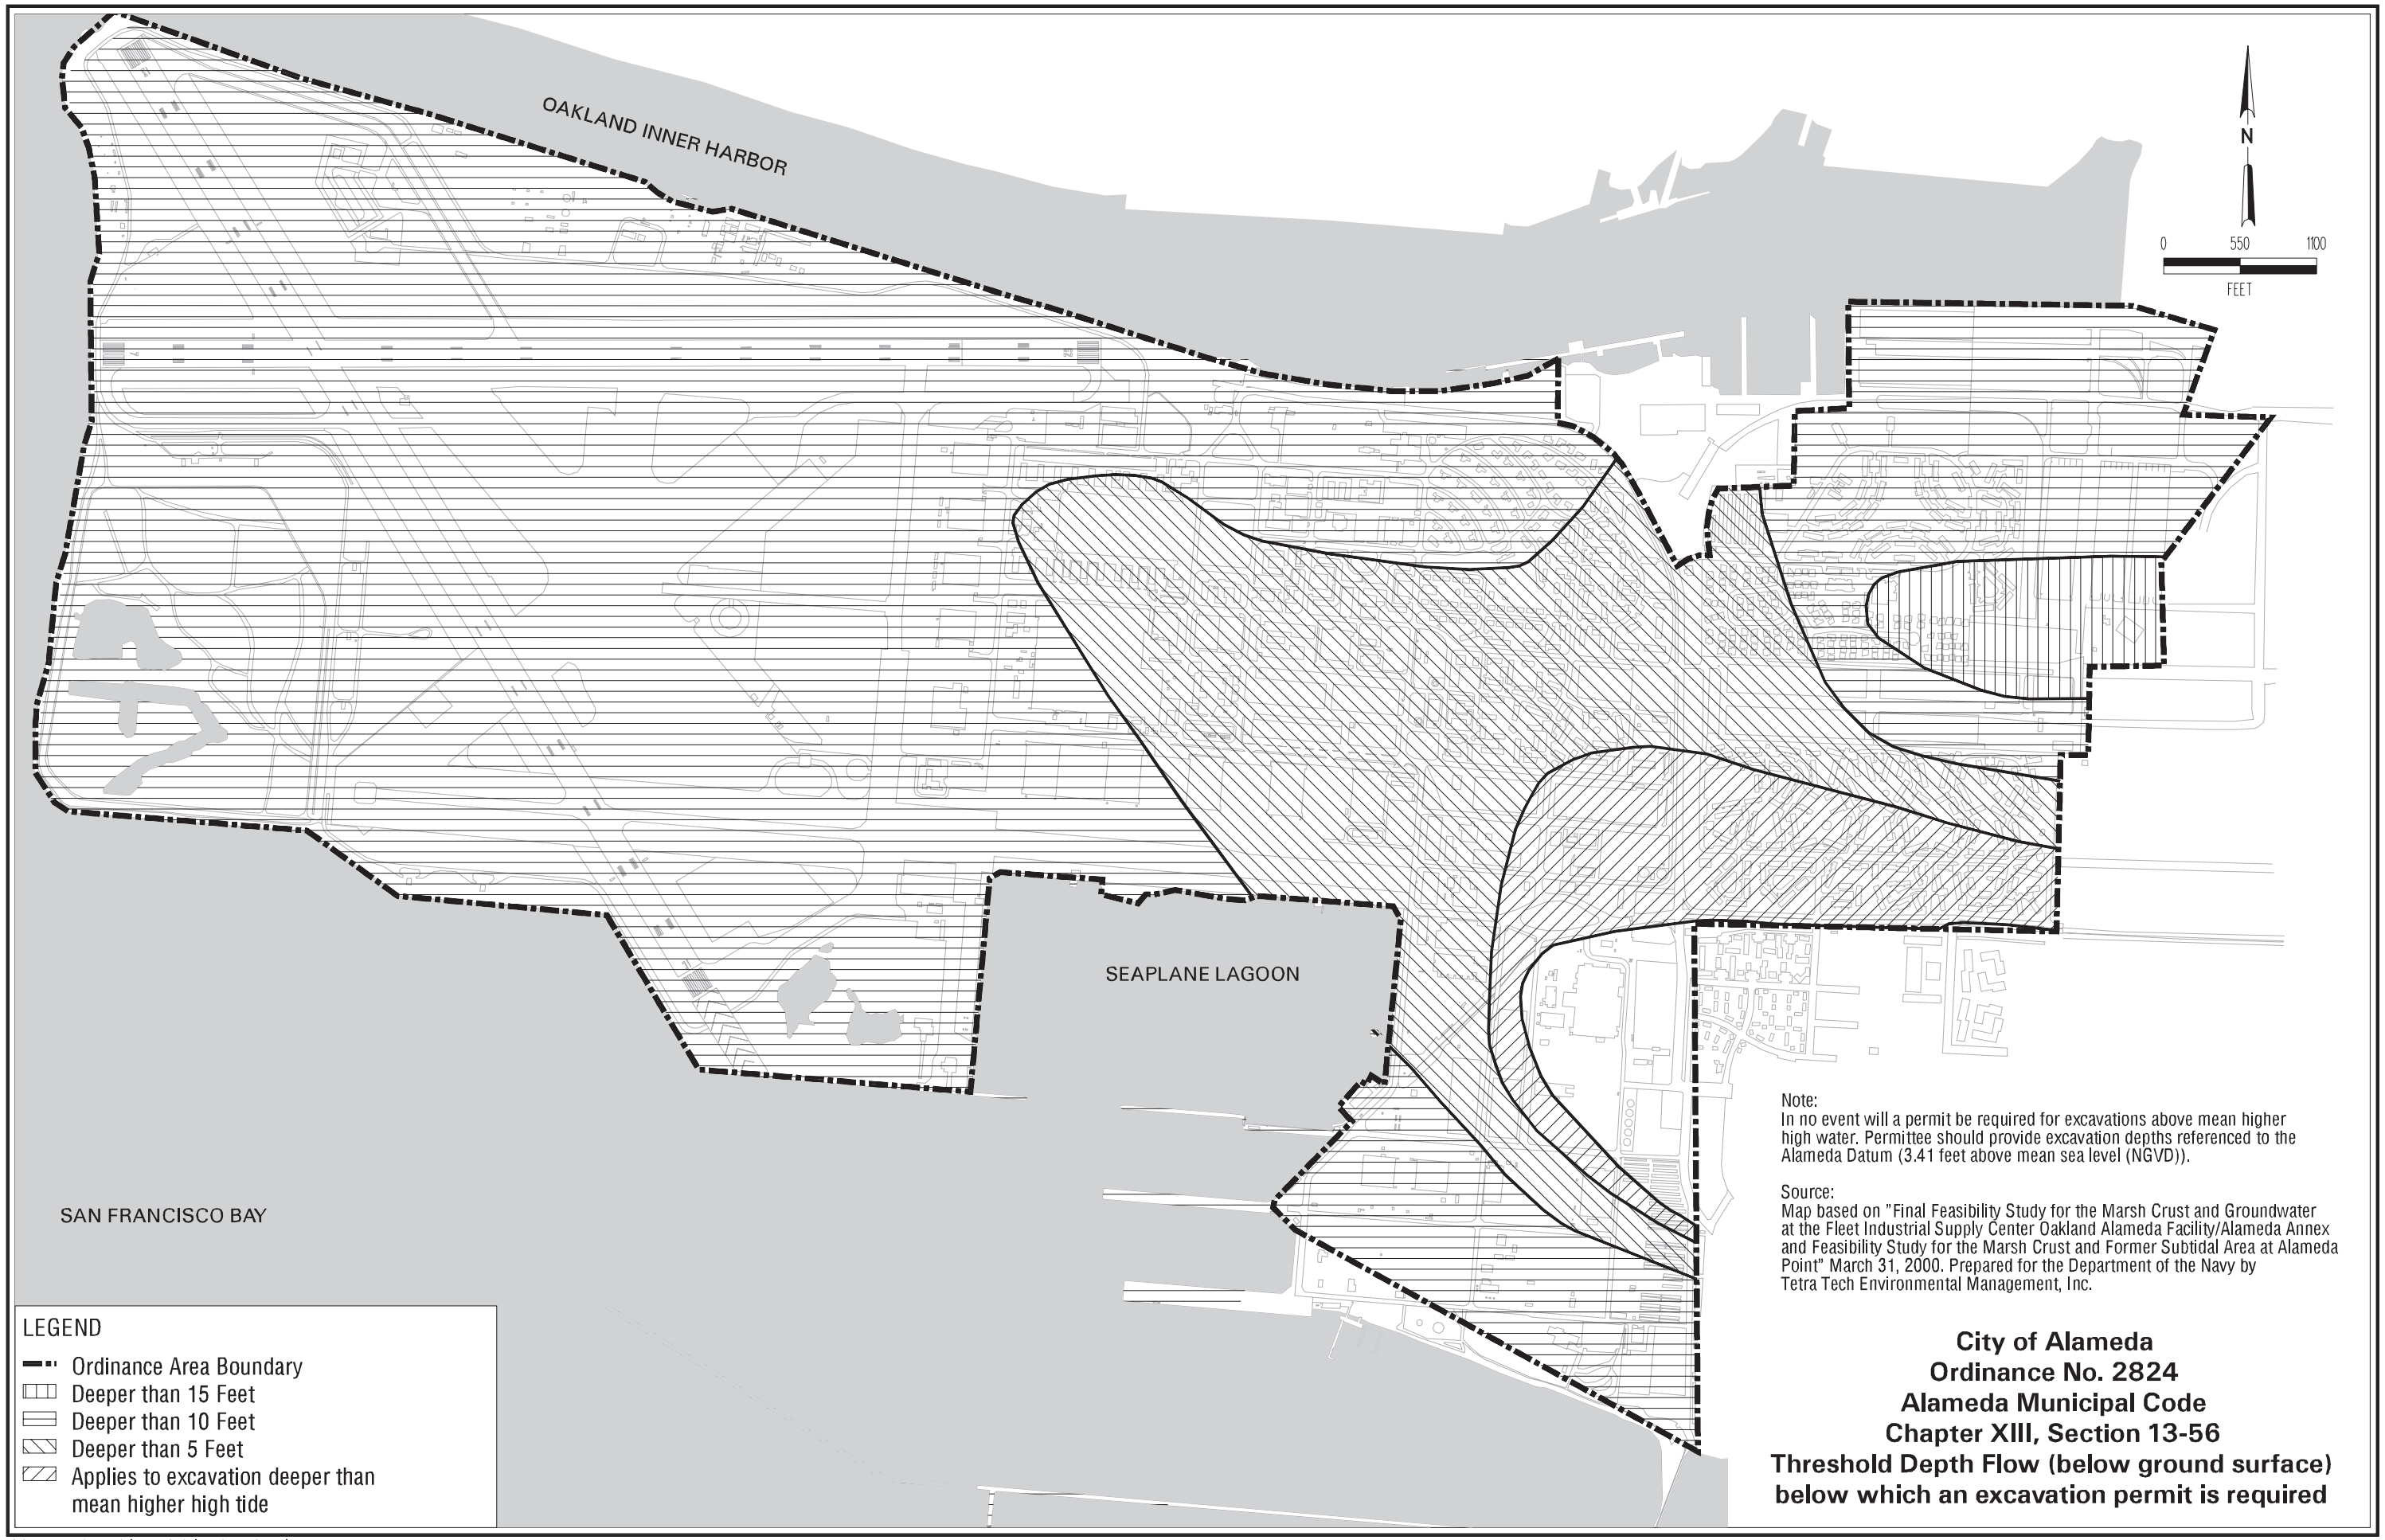

Note:
In no event will a permit be required for excavations above mean higher high water. Permittee should provide excavation depths referenced to the Alameda Datum (3.41 feet above mean sea level (NGVD)).

Source:
Map based on "Final Feasibility Study for the Marsh Crust and Groundwater at the Fleet Industrial Supply Center Oakland Alameda Facility/Alameda Annex and Feasibility Study for the Marsh Crust and Former Subtidal Area at Alameda Point" March 31, 2000. Prepared for the Department of the Navy by Tetra Tech Environmental Management, Inc.

City of Alameda
Ordinance No. 2824
Alameda Municipal Code
Chapter XIII, Section 13-56
Threshold Depth Flow (below ground surface) below which an excavation permit is required

d:/projects/misc/alameda/plots/map1.aml
30 Jun 00 10:29:16 Friday